
## GENERAL NOTES: (FIRE PROTECTION SYSTEM)

- 1. THE SPRINKLER SYSTEM SHALL BE DESIGNED ON ORDINARY HAZARD OCCUPANCIES.
- 2. ONLY NEW SPRINKLER DEVICE AND MATERIALS SHALL BE EMPLOYED IN THE INSTALLATION OF SPRINKLER SYSTEM.
- 3. A CONNECTION TO A RELIABLE WATER WORKS SYSTEM SHALL BE AN ACCEPTABLE WATER SUPPLY SOURCE.
- 4. TEST CONNECTION WHICH MAY BE ALSO BE USED AS DRAIN PIPE SHALL BE PROVIDED AT LOCATIONS THAT WILL PERMIT FLOW TEST TO BE MADE TO DETERMINE WHETHER WATER SUPPLIES AND CONNECTION ADD IN CEST TO
- A PRESSURE GAGE WITH A CONNECTION NOT SMALLER THAN 6MM SHALL BE INSTALLED ON THE RISER
   OR FEEDMAIN AT OR NEAR EACH TEST CONNECTION. THIS GAGE CONNECTION SHALL BE EQUIPPED
   WITH A SHUT-OFF VALVE AND WITH PROVISION FOR DRAINING.
- 6. THE REQUIRED PRESSURE GAGE SHALL BE AN APPROVED TYPE HAVE A MAXIMUM PRESSURE LIMIT NOT LESS THAN TWICE THE NORMAL WORKING PRESSURE AT THE POINT WHERE INSTALLED.
- 7. PIPES INSTALLED INA SPRINKLER SHALL BE MADE OF B.I. SCHEDULE 40 AND CAN WITHSTAND A PRESSURE OF NOT LESS THAN 175 PSI ( 12.1 BARS )
- BENDING OF PIPES MAY BE ACCOMPLISHED WHEN BENDS ARE MADE IN CONFORMANCE WITH GOOD INSTALLATION PRACTICES IN SHOWN NO KINKS. RIPPLES, DISTORTIONS, REDUCTION IN DIAMETER OR ANY NOTICEABLY DEVIATIONS FROM ROUND. THE MINIMUM RADIUS OF BEND SHALL BE 6 PIPE DIAMETER.
- ALL SPRINKLER SYSTEM SHALL BE ARRANGE FOR FLUSHING READILY REMOVABLE FITTINGS SHALL BE PROVIDED AT THE END OF ALL CROSS MAINS SHALL TERMINATE IN 32MM(11/4\*OR LARGER PIPE ALL BRANCH ALL BRANCH LINES SHALL BE ARRANGE TO FACILITATE FLUSHING.
- FIRE HOSE CONNECTION FOR ORDINARY HAZARD OCCUPANCY SHALL BE 63MM(2 1/2" AND SHALL BE ATTACHED TO A WET PIPE SPRINKLER RISER.
- 11. ALL PIPES SHALL BE PROTECTED AGAINST CORROSION.
- 12. FLEXIBLE COUPLINGS JOINING GROOVED AND PIPE SHALL BE PROVIDED AS FLEXURE JOINTS TO ALLOW INDIVIDUAL SECTION OF PIPING TO MORE DIFFERENTIALLY WITH THE INDIVIDUAL SECTIONS OF THE BUILDING TO WHICH IS ATTACHED COUPLINGS SHALL BE ARRANGE TO COINCIDE WITH STRUCTURAL OPERATION WITH IN BUILDING.
- 13. SWAY BRACING SHALL BE DESIGNED TO WITHSTAND A FORCE IN TENSION OR COMPRESSION EQUIVALENT TO NOT LESS THAN HALF WEIGHT OF WATER FILLED PIPING FOR INDIVIDUAL SWAY BRACES THE SLENDERNES SLENDERNESS RATIO L/R SHALL NOT EXCEED 200.
- 14. LONGITUDINAL SWAY BRACING SPACED AT A MAXIMUM OF 24M SHALL BE PROVIDED FOR FEED AND CROSS MAINS.
- 15. TOP OF RISER SHALL BE SECURED AGAINST DRIFTING IN ANY DIRECTION, UTILIZING FOR FEED AND CROSS MAINS.
- 16. PROVISION SHALL BE MADE TO PROPERLY DRAIN ALL PARTS OF THE SYSTEM.
- 17. EACH INTERIOR SECTIONAL CONTROL VALVE SHALL BE PROVIDED WITH DRAIN CONNECTION SO AS TO DRAIN THAT PORTION OF THE SYSTEM CONTROLLED BY SECTIONAL VALVE.
- 18. ALL THREADED FITTING AND PIPE SHALL THREAD CUT TO ASME STANDARD, CAN SHALL BE TAKEN THAT THE PIPE DOES NOT EXTEND INTO FITTINGS SUFFICIENTLY TO REDUCE THE WATER WAY.
- 19. JOIN COMPOUND OR TAPE SHALL BE APPLIED TO THE THREADS OF THE PIPE AND NOT ON THE FITTING.
- 20. WELDED SECTION OF SPRINKLER PIPING IS PLACE INSIDE THE BUILDING SHALL NOT BE PERMITTED. SECTION OF BRANCH LINES CROSS MAINS OR RISER MAY BE SHOP WELDED.
- 21. WHEN REDUCING A PIPE SIZE IN THE RUN OF A MAIN, CROSSMAIN, OR BRANCH LINE. A REDUCING FITTING DESIGN FOR THAT PROPOSE SHALL BE USED.
- 22. SECTIONS OF SHOP WELDED PIPING SHALL JOINED BY MEANS OF FLANGED OR FLEXIBLE GASKETED JOINTS OR OTHER APPROVED FITTINGS.
- 23. EACH SYSTEM SHALL BE PROVIDED WITH A LISTED INDICATING VALVE SO LOCATED AS TO CONTROL ALL SOURCE OF WATER SUPPLY EXCEPT FIRE DEPARMENT CONNECTION.
- $24. \ SPRINKLER\ PIPING\ SHALL\ BE\ SUBSTANTIALLY\ SUPPORTED\ FROM\ THE\ BUILDING\ STRUCTURE.$
- 25. SPRINKLER SYSTEM SHALL BE TESTED FOR WATER AND AIR LEAK FREE.
- 26. FIRE AND JOCKEY PUMPS SHALL BE FM OR UL APPROVED.
- 27. VALVES FITTINGS AND PRESSURE GAGES NOT SHOWN IN THE PLAN BUT DEAM NECESSARY FOR THE CONTINUITY OF THE FLOW SHALL BE PROVIDED.



mØ DRAIN VALVE


( SEE DETAIL )

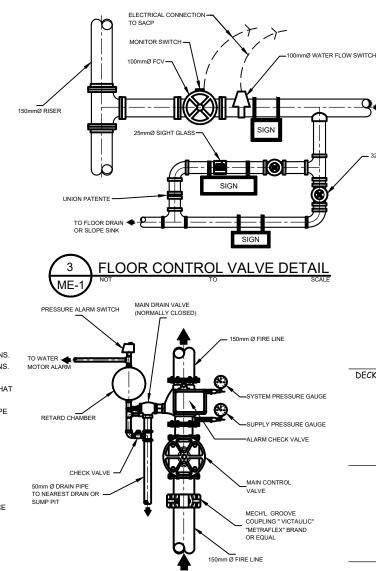

LEGEND AND SYMBOLS

	ABBREVIATIONS						
ABBREVIATIONS	DESCRIPTIONS	ABBREVIATIONS	DESCRIPTIONS				
AAV	AUTOMATIC AIR VENT	JPC	JOCKEY PUMP CONTROLLER				
ACV	ALARM CHECK VALVE	LPS	LITERS PER SECOND				
BV	BALL VALVE	LPM	LITERS PER MINUTES				
FDC	FIRE DEPARTMENT CONNECTION	PRV	PRESSURE REDUCING/RESTRI CTING RELIEF VALVE				
FHC	FIRE HOSE CABINET	TYP	TYPICAL				
FHV	FIRE HOSE VALVE	C/W	COMPLETE WITH				
RN	RISER NIPPLE	М	METER				
WFS	WATER FLOW SWITCH	ITC	INSPECTOR TEST CONNECTION				
GV	GATE VALVE	FPC	FIRE PUMP CONTROLLER				
GPM	GALLONS PER MINUTE						

1	SYMBOLS	DESCRIPTIONS	SYMBOLS	DESCRIPTIONS
1		FHC PIPE	†	QRS PENDENT SPRINKLER
7		UNDERGROUND PIPE	<b>†</b>	UPRIGHT SPRINKLER
1		CAPPED PIPE	<b>1</b>	QRS SIDEWALL SPRINKLER
I	MS	VALVE AND CAPPED PROVISION	Ī	ORS EXTENDED COVERAGE SIDEWALL SPRINKLER
1	<b>-&gt;4</b>	GATE VALVE	-	DIRECTION OF FLOW
7	X	ALARM CHECK VALVE	ļ	CONTINOUS PIPE
1	И	CHECK VALVE (SILENT TYPE)	1	UNION
7	M-3	DRAIN VALVE FOR PIPE END	<b>4</b> ,	PRESSURE GAGE WITH COCK
7	<b>—</b>	END CAP FOR FUTURE CONN.	A	4.5 KG ABC DRY CHEMICAL FIRE EXTINGUISHER
1		FIRE HOSE CABINET	A	4.5 KG HCFC 123 PORTABLE FIRE EXTINGUISHER
_	0	PUMP		22.7 KG WHEELED TYPE CO2 FIRE EXTINGUISHER
	FM	FLOW METER	£	ALARM BELL
	P	AUTOMATIC AIR RELEASE VALVE/ AUTOMATIC AIR VENT	*	FLOW SWITCH
	×	FIRE PUMP CONTROLLER	4	HOSE VALVE HEADER
		JOCKEY PUMP CONTROLLER	<b>2</b>	ELECTRICAL CONTROL PANEL

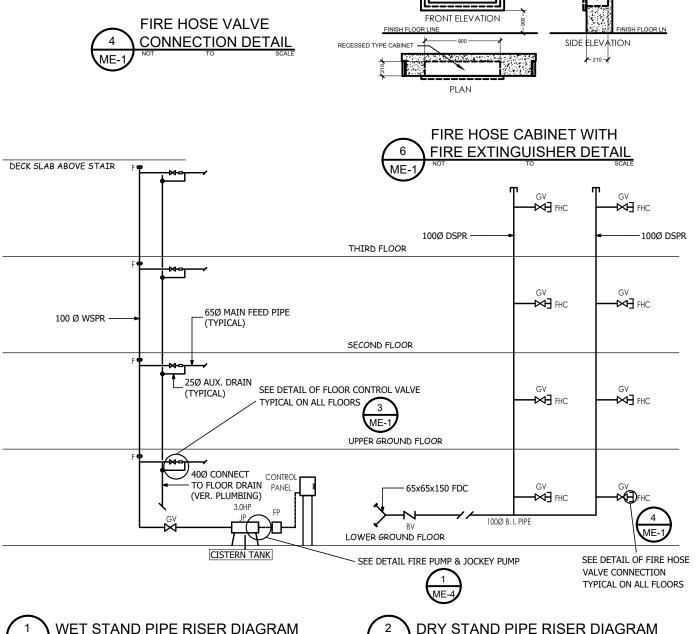

FINISH FLOOR )


FIRE EXTINGUISHER — 10 LBS DRY CHEMICAL


(ABC TYPE)


10mmØ PIPE PENETRATED


TO BE CAPPED

( BY SUB-STRUCTURE CONTRACTOR )

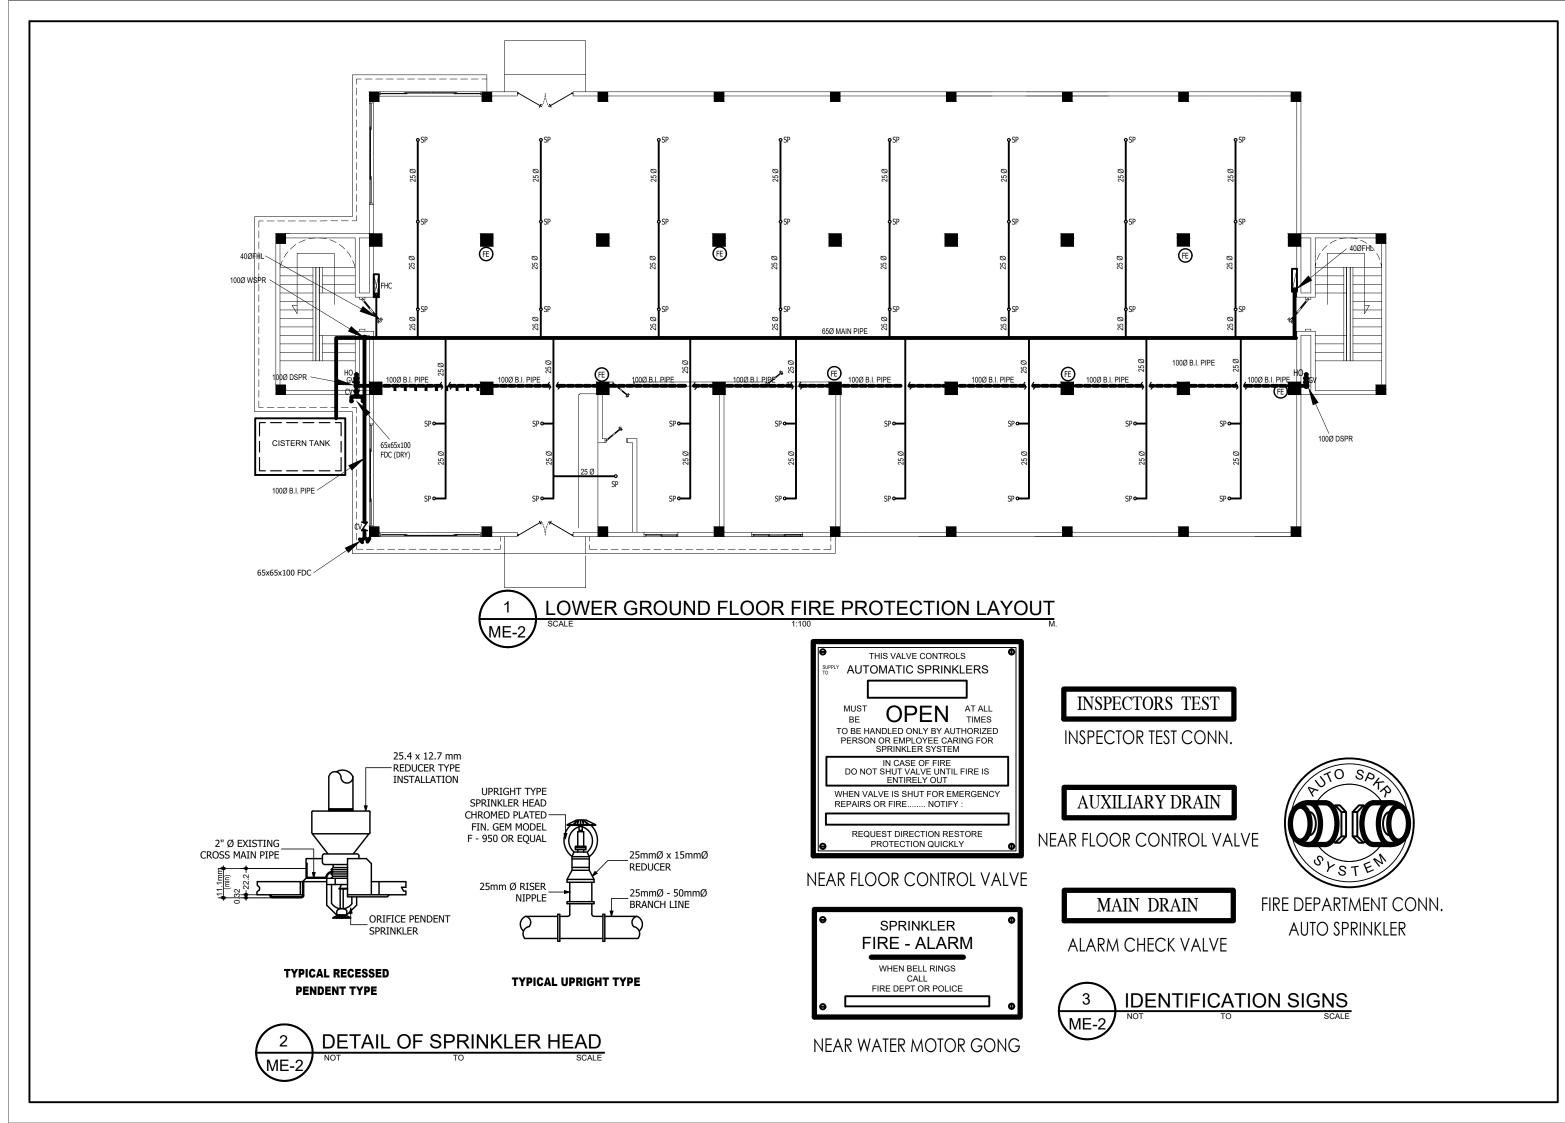

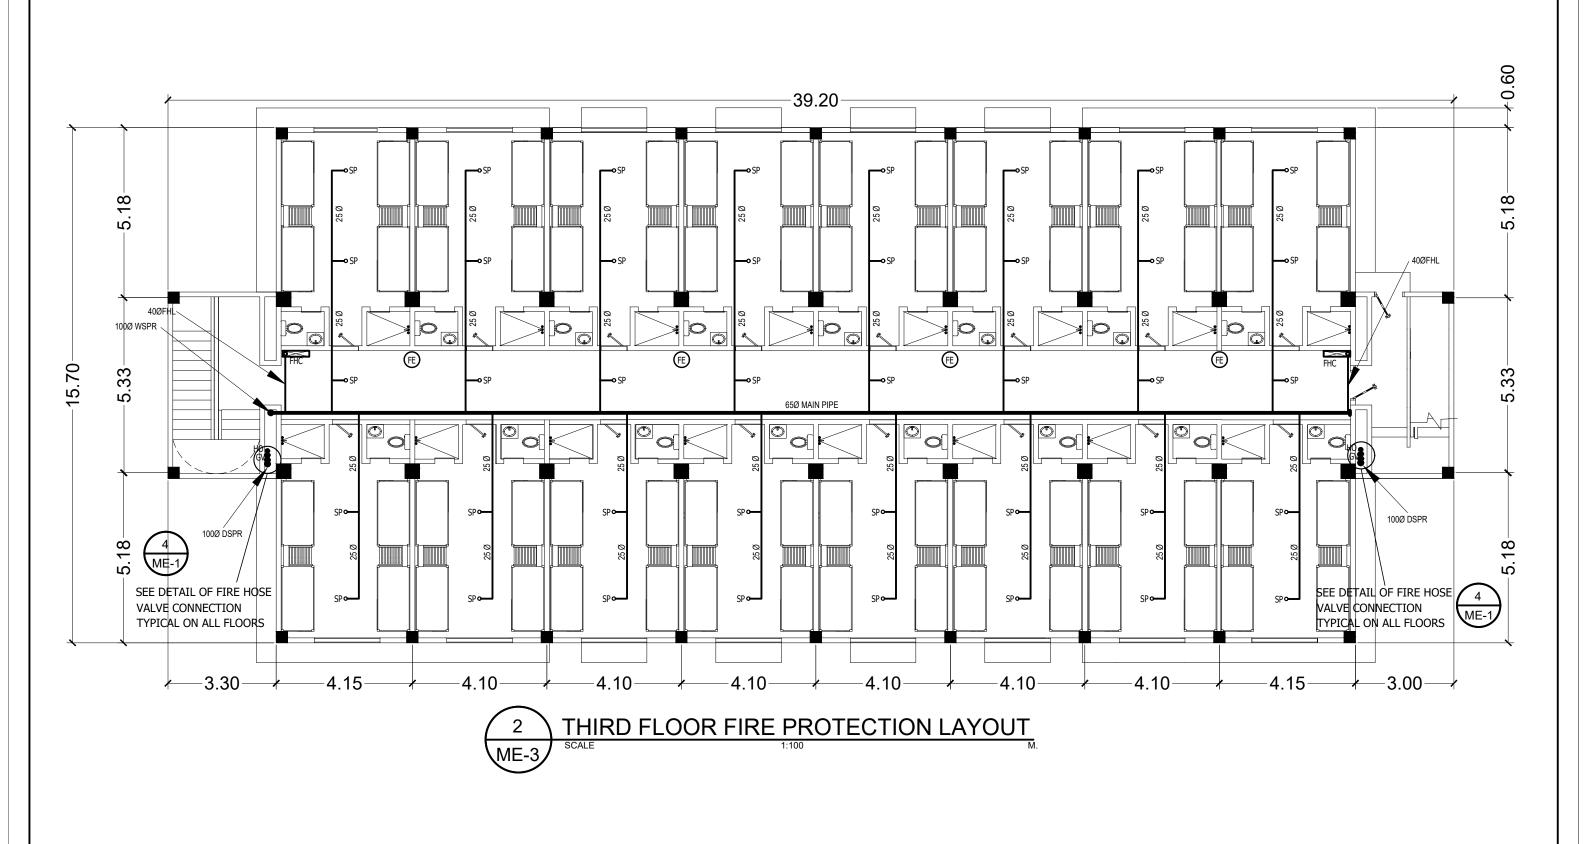

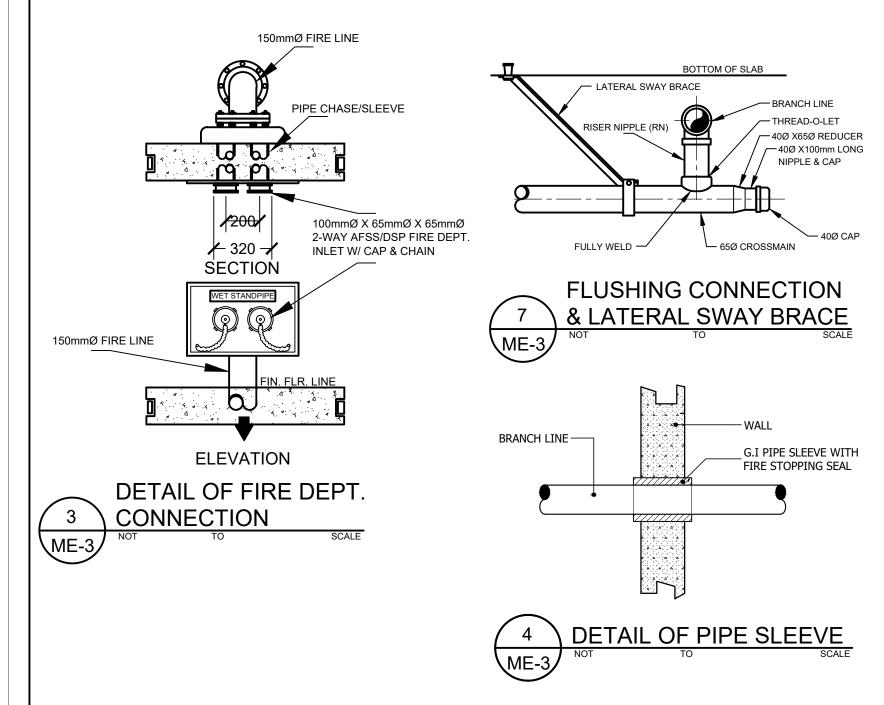

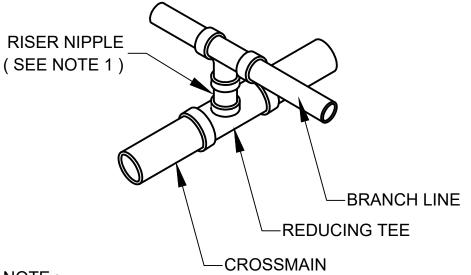


- NOTE:
- 1. ALTERNATIVE CONNECTION IS THRU
  THE USE OF BOLTED MECHANICAL
  BRANCH CONNECTION SIMILAR TO
  "VICTAULIC" MECHANICAL TEE OR
  CROSS. IF MECHANICAL CROSS IS
  USED. RISER NIPPLE IS NOT REQUIRED.
- 2. THE USE OF SCREWED CROSS FITTING IS NOT ACCEPTABLE
- 3. THE USE OF THREADOLET OR WELDOLET IS NOT ACCEPTABLE




## PUMP SCHEDULE

ME-4

MARK	SERVICE	TYPE	CAPACITY	APACITY HEAD FT (PSi)		ELECTRICAL SPECIFICATION				REMARKS
IVIARK	SERVICE	TTPE				HP	VOLTS	PHASE	Hz	REWARKS
FP 1	FIRE PUMP	HORIZONTAL SPLIT CASE TYPE	250 gpm	90	psi	20	220	3	60	• SEE SPECIFICATION FOR PUMP DESCRIPTION AND ACCESSORIES
JP 1	JOCKEY PUMP	HORIZONTAL SPLIT CASE	25 gpm	90	psi	3	220	3	60	ON EMERGENCY POWER

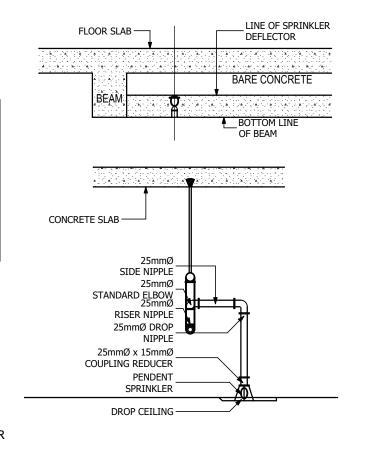


**DETAIL OF PENDENT / UPRIGHT CONNECTION** 

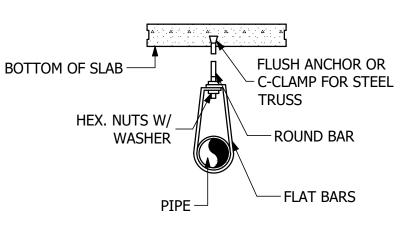


PIPE SIZE		STEEL PLATE BAR	ROD DIA.		
mm.	in.	(thick x width)	mm.	in.	
25	1	3.2 x 19 mm	9.5	3/8	
32	2.25	3.2 x 19 mm	9.5	3/8	
40	1.50	3.2 x 19 mm	9.5	3/8	
50	2	3.2 x 19 mm	9.5	3/8	


3 DETAIL OF ADJUSTIBLE FLAT IRN TYPE
ME-4 NOT TO SCALE

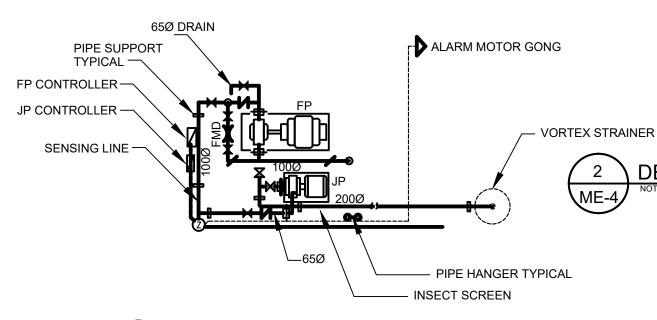

FIRE PUMP & JOCKEY PUMP DETAIL
NOT TO SCALE

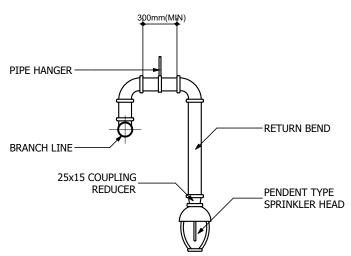



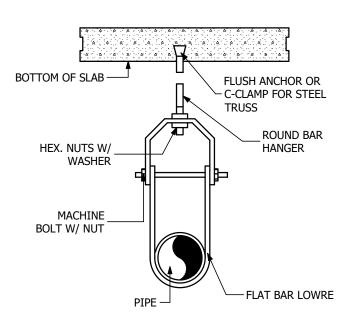

PIPE	PIPE SIZE STEEL PLATE BAR		ATE BAR	ROD DIA.		MACHINE BOLT W/NUT
mm.	in.	LOWER(thk x W)	LOWER(thk x W)	mm.	in.	(DIA. x L.) mm
50	2	3.2 x 25 mm	4.8 x 25 mm	9.5	3/8	9.5Ø x 100 mm. L
65	2 1/2	3.2 x 25 mm	4.8 x 25 mm	9.5	3/8	9.5Ø x 115 mm. L
80	3	3.2 x 25 mm	4.8 x 25 mm	9.5	3/8	9.5Ø x 127 mm. L
100	4	3.2 x 25 mm	4.8 x 25 mm	9.5	3/8	9.5Ø x 165 mm. L
150	6	4.8 x 32 mm	6.4 x 32 mm	12.0	1/2	12.0Ø x 216 mm. L

5 DETAIL OF ADJUSTIBLE CLEVER HANGER TYPE
ME-4 NOT SCALE